

# Fire Limit U.L. Fire Damper

## Model UL10D - Vertical or Horizontal



UNDERWRITERS' LABORATORIES  
 CLASSIFIED  
 FIRE DAMPERS  
 FIRE RESISTANCE RATING  
 NO. \_\_\_\_\_  
 SEE U.L. CLASSIFIED BUILDING MATERIAL INDEX

APPROVED BY THE  
 BOARD OF STANDARDS  
 AND APPEAL FOR USE  
 IN NEW YORK CITY  
 Cal. 291-80-SA

ACCEPTED FOR USE  
 CITY OF NEW YORK  
 DEPARTMENT OF BUILDINGS  
 MEA#:302-00-M

Available Options:  
 - Mounting Tabs

### VERTICAL MOUNT

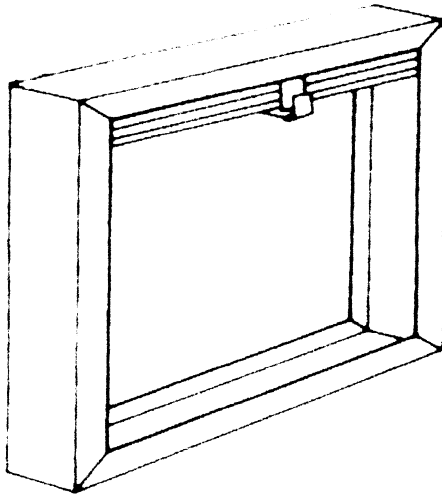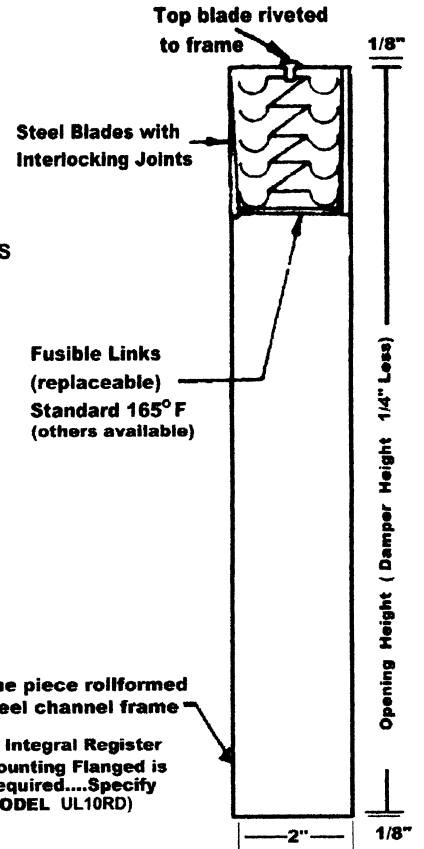

**TYPE D - 2" Deep channel frame, galvanized steel, horizontal or vertical**

**SPECIAL TYPES - variation of 2" deep channel frame are available incorporating the Type B or Type C construction : Types BD or CD**

**Maximum Single Section Size: 41" x 36"**

**Multiple section dampers are available in larger sizes; contact factory.**

Specifications for all material per Underwriters' Laboratories Standard for Safety UL 555-1979


Underwriters' Laboratories :

1 1/2 hour labelled dampers - (Model - UL10D)  
 for use in 2-hour partition

3 hour labelled damper - (Model - UL10DL)  
 for use in class A openings

Stainless steel negator closure spring

### HORIZONTAL MOUNT

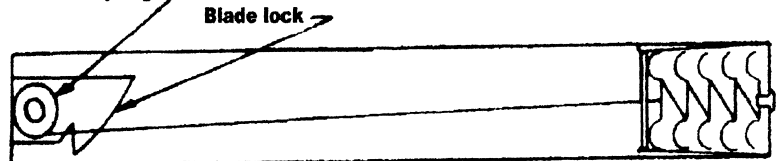

# arlan

DAMPER CORP.

1598 Lakeland Ave., Bohemia, L.I., N.Y. 11716

T:631-589-7431 F:(631)589-7558 e-mail:Arlandcorp@aol.com

JOB

LOCATION

ARCH/ENG.

CONTRACTOR